

KENTFIELD FIRE PROTECTION DISTRICT



Developed by
Jim Galli, Battalion Chief
Approved by
Paul Smith, Fire Chief

Fire Protection Standard 521

Bonfires

Date: 1-1-04

Revision: _____

Page: 1 of 2

This standard has been developed pursuant to Article 11 of the Uniform Fire Code as adopted by ordinance by the Kentfield Fire Protection District. It is intended that this standard be used as a guide in establishing the minimum requirements for fire and life safety relative to bonfires.

I. Permits

A. A Fire District permit is required to kindle any bonfire or recreational campfire on public or private property. A permit application shall be completed and returned to the Fire Loss Management Division with the application fee for processing.

Exception: Any campfire in an approved barbecue pit at a County and State Park.

B. Confirmation shall be received by the Fire District that the intended fire complies with all regulations of the Bay Area Pollution Control District or is exempt therefrom. Copies of permits required by the Bay Area Pollution Control District shall be submitted to the Fire District as a part of the application process.


C. The Fire District permit, when issued, shall be kept at all time in the possession of the permittee or responsible party on-site during the hours of burning established within the guidelines of the permit.

II. Conditions of Permit

A. Areas for burning shall be approved and designated by the Fire Marshal prior to issuing any permit.

B. Areas shall be cleared of all vegetation (to bare earth) for a distance of not less than the total width times the height of the fire circle.

Example:

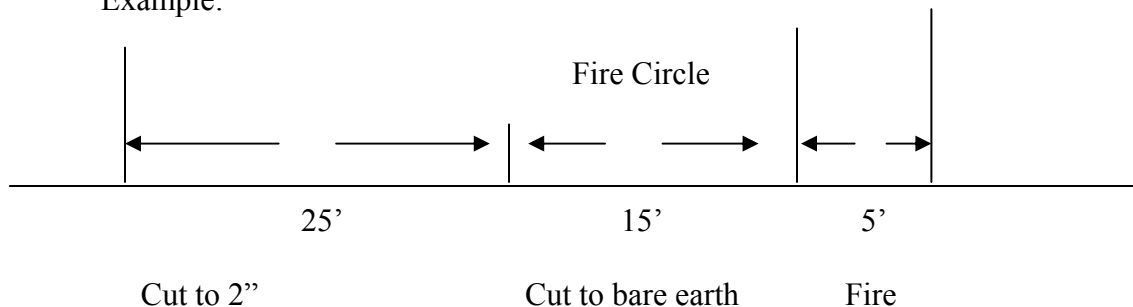

An additional 25' of brush, grass, overhanging trees and other shrubbery shall be cleared to within 2" from the ground level.

KENTFIELD FIRE PROTECTION DISTRICT



Developed by

Jim Galli, Battalion Chief

Approved by

Paul Smith, Fire Chief

Fire Protection Standard 521

Bonfires

Date: 1-1-04

Revision: _____

Page: 2 of 2

- C. The fire circle shall be constructed of rocks or other similar non-combustible materials or an approved barbecue pit. The height of the rocks of the circle perimeter shall be (in inches) the same as the diameter of the circle (in feet). This is to prevent burning pieces from rolling away from the fire circle.
- D. Fires shall be constantly attended by a competent adult until such fire is extinguished.
- E. The Fire Chief may prohibit any or all bonfires, including permit revocation, when atmospheric conditions or local circumstances make such fires hazardous.
- F. A garden hose connected to a suitable water supply shall be readily available for use. The garden hose shall be capable of reaching at least to the outermost diameter of the fire circle.
- G. A minimum of one 2 1/2 gallon pressurized water extinguisher shall be located within 30' travel distance from the fire circle. The permittee shall be knowledgeable and trained in the handling and operation of such fire extinguisher.